


Montagehinweis Kippindikator

Achtung: Mögliche Beschädigung des Verdichters bei ausgelöstem Kippindikator


Kompressoren müssen aufrecht transportiert und montiert werden, da sonst Öl austritt oder sich in unerwünschten Bereichen sammelt. Das kann zu einem Verlust der thermischen Leistung, einem erhöhten Stromverbrauch oder einem Ausfall der Wärmepumpe führen.

Um prüfen zu können, ob sich der gelieferte Kompressor zu jedem Zeitpunkt des Transports in aufrechter Position befand, ist ein Kippindikator außen am Karton angebracht. Bitte stellen Sie sicher, dass sich das farbige Glaskügelchen innerhalb des Kippindikators noch immer im Feld „30°“ befindet.

Sollte sich das Glaskügelchen in einem anderen Bereich des Kippindikators befinden als zuvor angegeben, wurde die Palette gekippt und der Kompressor sollte nicht mehr verbaut werden. Reklamieren Sie in diesem Fall unverzüglich beim Versanddienstleister. Bitte wenden Sie sich an unser Kundencenter, um die Rückholung zu organisieren.

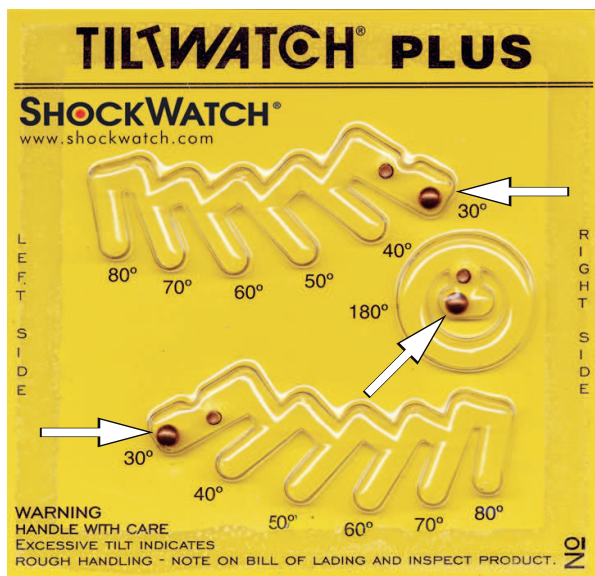

Originalzustand

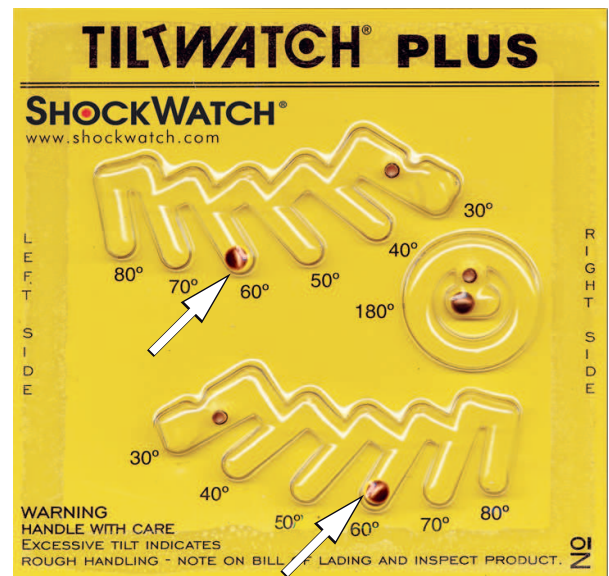

Palette wurde gekippt

Abb. 1: Ansicht des Kippindikators im Originalzustand (Zustand i.O.) bzw. falls Palette beim Transport gekippt wurde (Beispiel, Zustand nicht i.O.)

Note of installation for tilt indicator

Caution: Possible damage to the compressor if the tilt indicator is triggered

Compressors must be transported and installed upright, otherwise oil will leak or collect in undesirable areas. This can lead to a loss of thermal performance, increased power consumption or failure of the heat pump.

To check whether the delivered compressor was in an upright position at all times during transportation, a tilt indicator is attached to the outside of the box. Please ensure that the colored glass bead inside the tilt indicator is still in the "30°" field.

If the glass bead is located in a different area of the tilt indicator than previously indicated, the pallet has been tilted and the compressor should no longer be installed. In this case, make a complaint to the shipping service provider immediately. Please contact our customer center to organize the return.

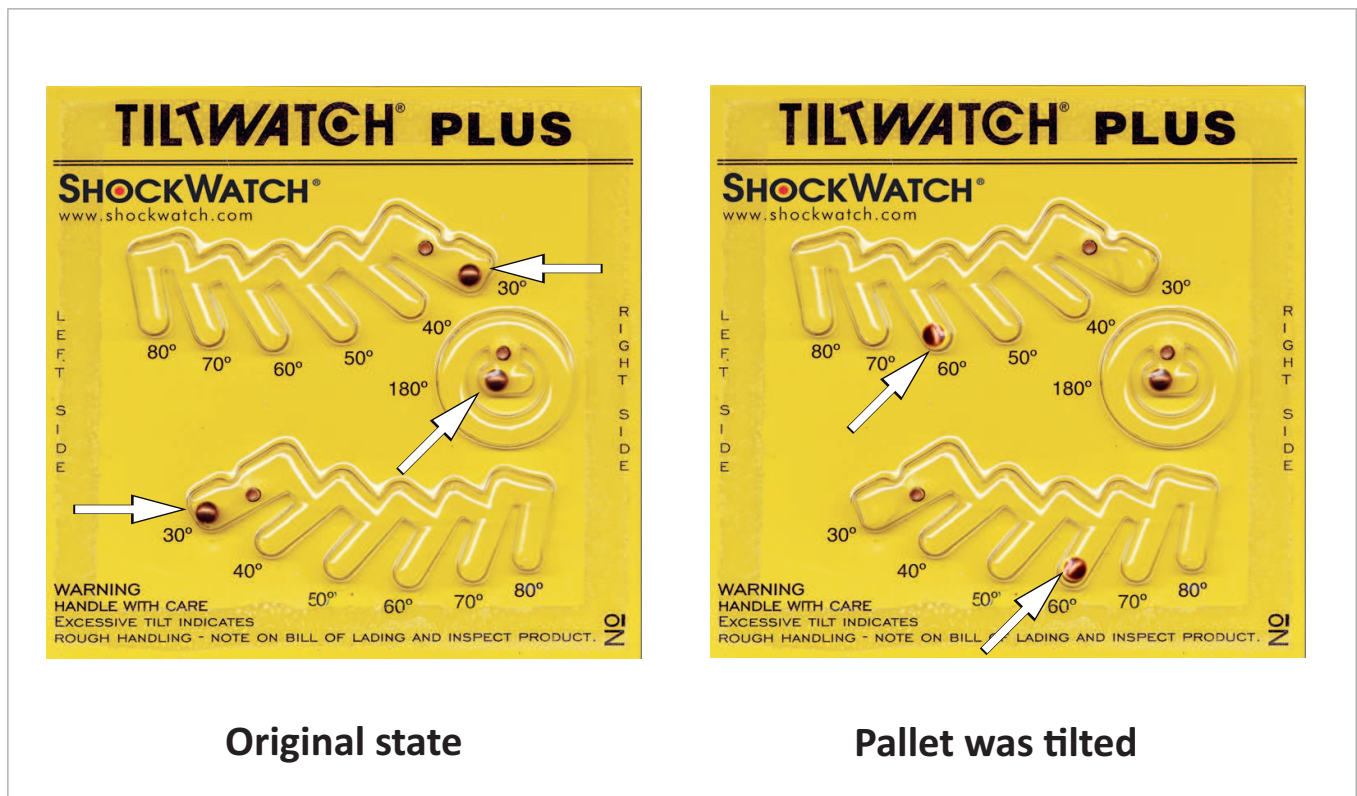


Fig. 2: View of the tilt indicator in its original state (condition OK) or if the pallet was tilted during transportation (example, condition not OK)

